

SF-C10 SERIES

Related Information

■ General terms and conditions..... P.1

■ SF4B / SF2B P.481~ / P.515~

■ General precautions P.1027

■ Korea's S-mark..... P.1034~

FIBER
SENSORSLASER
SENSORSPHOTOELECTRIC
SENSORSMICRO
PHOTOELECTRIC
SENSORSAREA
SENSORSSAFETY
COMPONENTSPRESSURE
SENSORSINDUCTIVE
PROXIMITY
SENSORSPARTICULAR
USE SENSORSSENSOR
OPTIONSWIRE-SAVING
SYSTEMSMEASUREMENT
SENSORSSTATIC CONTROL
DEVICESLASER
MARKERSSUNX website <http://www.sunx.com>

Less setup time for safety circuits

Plug-in type control unit

SF-C11 / SF-C14EX

Quick-connection


Connecting to the light curtain is done using plug-in connections, which shortens setup and replacement time.



Easy setup requiring no torque control

A spring method is used for the terminal blocks for connections other than to the light curtain. There is no need to control tightening torques for these terminal blocks.


Uses a spring method!

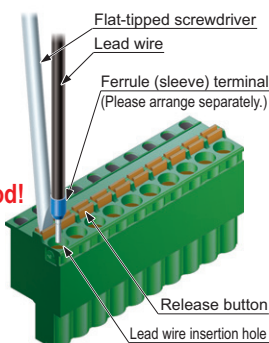

Removable terminal blocks reduce maintenance time

Removable terminal blocks are used. This reduces the work required for reconnecting wiring during maintenance.

Removable!

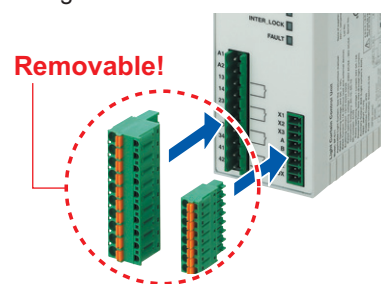

Robust type control unit

SF-C12

Metal enclosure with a IP65 protective structure

The strong metal enclosure has a built-in safety relay. It has an IP65 protective structure, so that it can be set up individually without needing to be inserted into a control panel.




Connecting to the light curtain is done using plug-in connector connections

Slim type control unit

SF-C13



Slim design

22.5 mm 0.886 in thickness, so can be inserted even into narrow spaces inside panels.

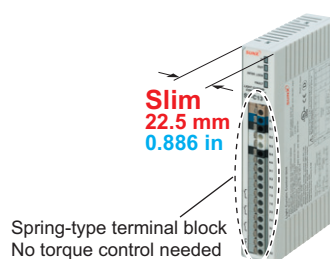

ORDER GUIDE
P.554SPECIFICATIONS
P.555~WIRING DIAGRAMS
P.557~PRECAUTIONS FOR PROPER USE
P.560~DIMENSIONS
P.562**Building of muting control circuits is easy****SF-C14EX****The method used to build the safety circuit is selectable**


It is possible to build muting control circuits using a stand-alone light curtain from the **SF4B** series. The newly-released **SF-C14EX** application expansion unit allows the light curtain, muting sensors and muting lamps to be connected together directly, so that muting control circuits can be built very easily.

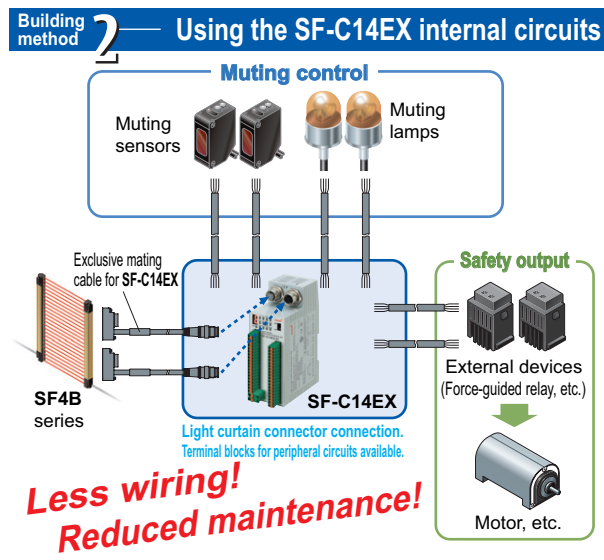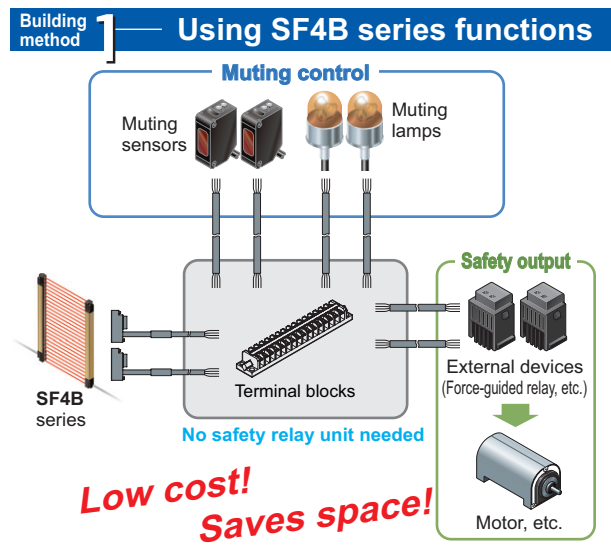**Both safety and productivity can be obtained by stopping only one part of the device **SF-C14EX******Three safety circuit systems packaged into a single unit!**

Three safety circuit systems ① **Light curtain output circuit**, ② **Muting control circuit**, and ③ **Emergency stop circuit** are packaged into a single unit. Functions that require multiple safety relay units and muting control units can be concentrated into a single unit, which results in large space savings, less wiring and less installation work.


High-speed response 14 ms (Including light curtain)

High-speed response has been achieved due to the adoption of the semiconductor output. Avoids the response delays that occur when using more than one safety relay unit, and greatly reduces the light curtain safety distance and improves ease of working. Of course, it is not necessary to exchange the safety relays within the unit anymore, which contributes to the reduction of running cost.

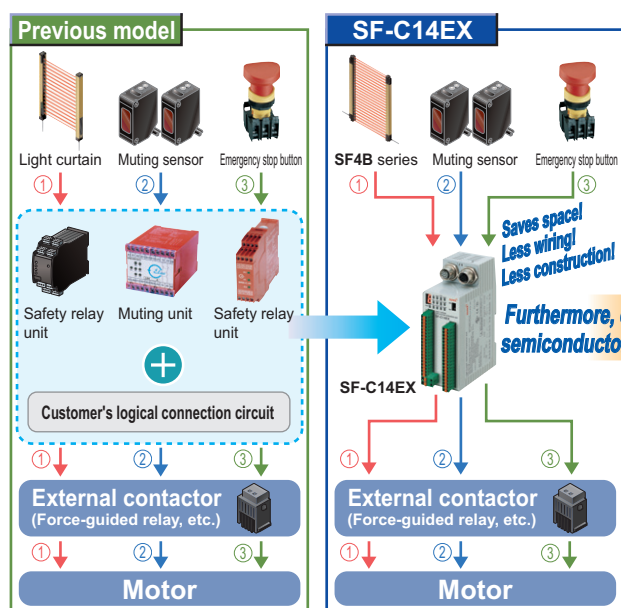

① Light curtain output circuit ② Muting control circuit
③ Emergency stop circuit

Including light curtain response time
High response speed of 14 ms!
Greatly reduced safety distance!

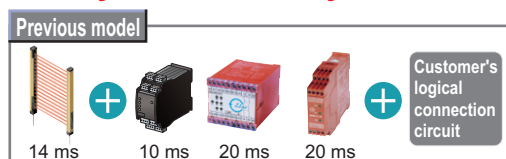

FIBER SENSORS

LASER SENSORS

PHOTOELECTRIC SENSORS

MICRO PHOTOELECTRIC SENSORS

AREA SENSORS

SAFETY COMPONENTS

PRESSURE SENSORS

INDUCTIVE PROXIMITY SENSORS

PARTICULAR USE SENSORS

SENSOR OPTIONS

WIRE-SAVING SYSTEMS

MEASUREMENT SENSORS

STATIC CONTROL DEVICES

LASER MARKERS

Selection Guide

Light Curtains

SF4B**SF2B****BSF4-AH80**

Control Units

SF-C10

Optical Touch Switch

SW-101Other Products
Definition of
Sensing Heights

FIBER
SENSORSLASER
SENSORSPHOTOELECTRIC
SENSORSMICRO
PHOTOELECTRIC
SENSORSAREA
SENSORSSAFETY
COMPONENTSPRESSURE
SENSORSINDUCTIVE
PROXIMITY
SENSORSPARTICULAR
USE SENSORSSENSOR
OPTIONSWIRE-SAVING
SYSTEMSMEASUREMENT
SENSORSSTATIC CONTROL
DEVICESLASER
MARKERSSelection
Guide

Light Curtains

SF4B**SF2B****BSF4-AH80**

Control Units

SF-C10Optical Touch
Switch**SW-101**Other
Products
Definition of
Sensing Heights

Three safety circuit systems can be controlled independently so that equipment can be stopped all together or partially **SF-C14EX**

Motors that use muting control and those that do not use it can be controlled independently!

Controls the motors that use muting control (robots) and the motors that do not use muting control (turntables) with a single unit.

When the workpiece comes in, the turntable can be stopped and the robot can keep operating condition, to protect the safety of the operator and to maintain productivity.

Safety circuit ① : Linked to light curtain beam received / interrupted status (partial stop)

When the light curtain is interrupted (when a workpiece enters or a person intrudes), this circuit switches off (open) the safety output and stops the turntable.


Safety circuit ② : Linked to muting control (partial stop)

If a workpiece enters when the turntable has stopped normally, (muting conditions are achieved), this circuit allows the robot to operate.

If a workpiece enters while the turntable is turning (muting conditions are not achieved), this circuit switches off (open) the safety output and stops the robot.

Safety circuit ③ : Linked to emergency stop input (all stop)

When the emergency stop button is pressed, this circuit switches off (open) the safety output and stops all equipment (turntable and robot).

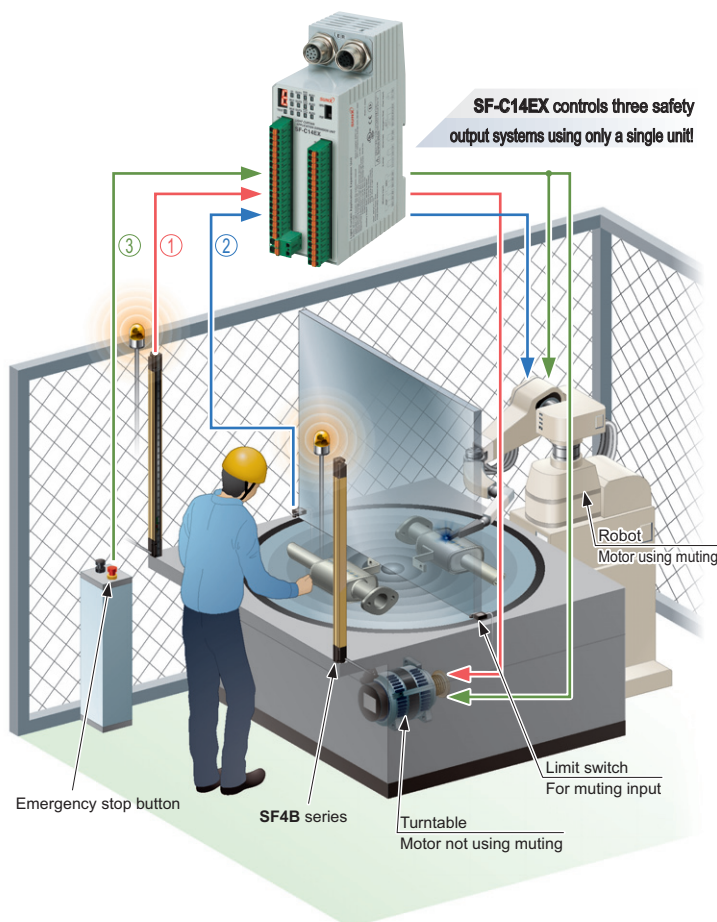


Equipped with blown lamp output for muting lamp

If a lamp in one of the two muting lamps that are connected to the unit blows, a warning is output. It is possible to replace the lamp before both lamps blow and the equipment stops. In addition, auxiliary output that is linked to the muting function, override function and light curtain control output is also available.

	Function	Operation
Auxiliary output 1	Muting output	ON when the muting function is invalid
Auxiliary output 2	Override output	ON when the override function is invalid
Auxiliary output 3	Blown lamp output	ON when the muting lamp is normal
Auxiliary output 4	Light curtain auxiliary output	ON when the light curtain is in light interrupted condition

Equipped with a digital indicator so that error details can be understood at a glance!


If a problem should occur, the same output (OFF signal) as when the object was detected is maintained in order to ensure safety, and the details of the error appear on the digital display.

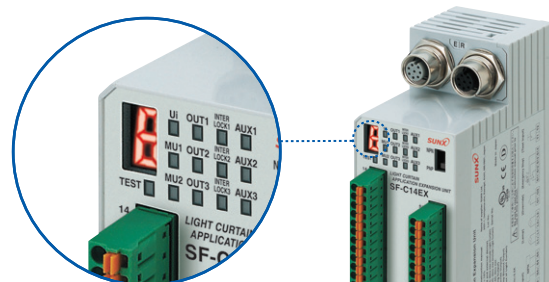





Supports both PNP and NPN polarities

All Models

A single model can be used for PNP / NPN input switching, reducing the number of parts that need to be registered.

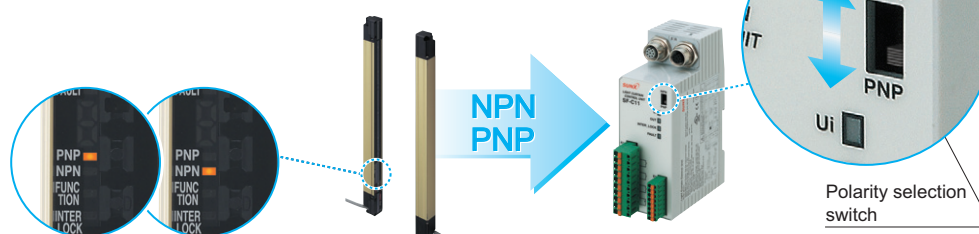

ORDER GUIDE

Designation	Appearance	Model No.	Applicable cable	Description
Connector connection type control unit		SF-C11	Light curtain connection cable: SFB-CB□ (For SF4B series) SF2B-CB□ (For SF2B series) Extension cable: SFB-CCJ10□	Use 8-core cable with connector to connect to the light curtain. Compatible with up to control category 4. Interference prevention wires and muting function cannot be used.
Robust type control unit		SF-C12	Light curtain connection cable: SFB-CB05-MU Extension cable: SFB-CCJ10□-MU	Use 12-core cable with connector to connect to the light curtain. Interference prevention wires can be used. Compatible with up to control category 4. Muting function cannot be used.
Slim type control unit		SF-C13	Light curtain connection cable: SFB-CCB□(-MU) (For SF4B series) SF2B-CCB□ (For SF2B series) Extension cable: SFB-CC□(-MU)	Use a discrete wire cable to connect to the light curtain. Muting function and interference prevention wires can be used. Compatible with up to control category 4.
Application expansion unit for the SF4B series	 <small>Handy-controller non-compatible type</small>	SF-C14EX SF-C14EX-01	Light curtain connection cable: SFB-CB□-EX Extension cable: SFB-CCJ10□	The muting control function and emergency stop input are equipped, expanding the applications of the light curtains. It can be connected to the light curtains using the exclusive connection cable. Compatible with up to control category 4.

Note: Refer to the **SF4B** series (p.488~) and **SF2B** series (p.520~) for details of applicable cable.

SF-C12 spare relay set

A set of spare relays (2 safety relays and 1 removal tool) is available for the safety relay that is built into the **SF-C12**.
Model No.: **SF-C12-RY**

FIBER
SENSORSLASER
SENSORSPHOTO-
ELECTRIC
SENSORSMICRO
PHOTO-
ELECTRIC
SENSORSAREA
SENSORS**SAFETY
COMPONENTS**PRESSURE
SENSORSINDUCTIVE
PROXIMITY
SENSORSPARTICULAR
USE
SENSORSSENSOR
OPTIONSWIRE-
SAVING
SYSTEMSMEASURE-
MENT
SENSORSSTATIC
CONTROL
DEVICESLASER
MARKERSSelection
Guide
Light
Curtains**SF4B****SF2B****BSF4-AH80**Control
Units**SF-C10**Optical Touch
Switch**SW-101**Other
ProductsDefinition of
Sensing Heights

SPECIFICATIONS

Model No.	SF-C11	SF-C12	SF-C13
Item			
Connectable light curtains	SF4B / SF2B series		Light curtain manufactured by SUNX
Applicable standards	IEC 61496-1, UL 61496-1, JIS B 9704-1		
Control category	ISO 13849-1 (EN 954-1, JIS B 9705-1) compliance up to Category 4 standards		
Supply voltage / Current consumption	24 V DC $\pm 10\%$ Ripple P-P 10 % or less / 100 mA or less (without light curtain)		
Fuse (power supply)	Built-in electronic fuse, Triggering current: 0.5 A or more, Reset after power down		
Enabling path	NO contact $\times 3$ (13-14, 23-24, 33-34)	NO contact $\times 2$ (13-14, 23-24)	NO contact $\times 3$ (13-14, 23-24, 33-34)
Application category	AC-15, DC-13 (IEC 60947-5-1)		
Rated operation voltage (Ue) / Rated operation current (Ie)	30 V DC / 6 A, 230 V AC / 6 A, resistive load (For inductive load, during contact protection) Min. applicable load: 10 mA (at 24 V DC) (Note 2)	24 V DC / 1 A, resistive load (For inductive load, during contact protection) Min. applicable load: 15 mA (at 24 V DC)	30 V DC / 4 A, 230 V AC / 4 A, resistive load (For inductive load, during contact protection) Min. applicable load: 10 mA (at 24 V DC) (Note 2)
Contact material / contacts	AgSnO, self cleaning, positively driven	AgNiO + 0.2 μm 0.008 mil Au plating, self cleaning, positively driven	AgSnO, self cleaning, positively driven
Contact resistance	100 m Ω or less (initial value)	50 m Ω or less (initial value)	100 m Ω or less (initial value)
Contact protection fuse rated	6 A (slow blow)	3 A (slow blow)	4 A (slow blow)
Mechanical lifetime	10 million operations or more (switching frequency 180 operations/min.) (Note 3)		
Electrical lifetime	100,000 operations or more (switching frequency 20 operations/min., 230 V AC / 3 A resistive load) (Note 3)		
Pick-up delay (Auto reset / Manual reset)	80 ms or less / 90 ms or less	30 ms or less / 30 ms or less	80 ms or less / 90 ms or less
Response time	10 ms or less	14 ms or less	10 ms or less
Auxiliary output	Safety relay contact (NC contact) $\times 1$ (41-42) (Related to enabling path)	Safety relay contact (NC contact) $\times 1$ (31-32) (Related to enabling path)	Safety relay contact (NC contact) $\times 1$ (41-42) (Related to enabling path)
Rated operation voltage / current	24 V DC / 2 A, Min. applicable load: 10 mA (at 24 V DC)	30 V DC / 3 A, Min. applicable load: 15 mA (at 24 V DC)	24 V DC / 2 A, Min. applicable load: 10 mA (at 24 V DC)
Contact protection fuse rated	2 A (slow blow)	3 A (slow blow)	2 A (slow blow)
Semiconductor auxiliary output (AUX)	<Minus ground (Setting for PNP)> • Max. source current: 60 mA • Applied voltage: same as supply voltage (between the semiconductor auxiliary output and +V) • Residual voltage: 2.3 V or less (at source current 60 mA) • Leakage current: 2 mA or less <Plus ground (Setting for NPN)> • Max. sink current: 60 mA • Applied voltage: same as supply voltage (between the semiconductor auxiliary output and 0 V) • Residual voltage: 1.5 V or less (at sink current 60 mA) • Leakage current: 2 mA or less	—————	PNP open-collector transistor • Max. source current: 60 mA • Applied voltage: same as supply voltage (between the semiconductor auxiliary output and +V) • Residual voltage: 2.3 V or less (at source current 60 mA) • Leakage current: 2 mA or less
Output operation	Related to auxiliary output of light curtain	—————	On when the light curtain is interrupted
Excess voltage category	III		
Indicators	Green LED (lights up when the power is ON)		
Power supply (Ui)	Green LED (lights up when enabling contacts are closed)		
Enabling path [OUT (Note 4)]	Green LED (lights up when enabling contacts are closed)		
Interlock (INTER_LOCK)	Yellow LED (lights up when enabling contacts are opened)	—————	Yellow LED (lights up when enabling contacts are opened)
Fault (FAULT)	Yellow LED (blinks when fault occurs)	Orange LED (lights up when two light curtain input polarity selection switch settings are different)	Yellow LED (blinks when fault occurs)
External relay monitor function	Incorporated	Incorporated (Note 5)	Incorporated
Trailing edge function	Incorporated		
Polarity selection function (Note 6)	Incorporated (Sliding switch allows selection of plus / minus ground) Minus ground: Correspond to PNP output light curtain Plus ground: Correspond to NPN output light curtain		Incorporated (Cable connection allows selection of plus / minus ground) Minus ground: Correspond to PNP output light curtain Plus ground: Correspond to NPN output light curtain
Pollution degree	2		
Environmental resistance	Protection (Note 7)	Enclosure: IP40, Terminal: IP20	IP65
Ambient temperature	-10 to +55 °C +14 to +131 °F (No dew condensation or icing allowed), Storage: -25 to +70 °C -13 to +158 °F		
Ambient humidity	30 to 85 % RH, Storage: 30 to 95 % RH	35 to 85 % RH, Storage: 35 to 85 % RH	30 to 85 % RH, Storage: 30 to 95 % RH
Vibration resistance	10 to 55 Hz frequency, 0.35 mm 0.014 in amplitude in X, Y, and Z directions for twenty times each	10 to 55 Hz frequency, 0.75 mm 0.030 in amplitude in X, Y, and Z directions for two hours each	10 to 55 Hz frequency, 0.35 mm 0.014 in amplitude in X, Y, and Z directions for twenty times each
Connection terminal	Detachable-type spring gauge terminal	European terminal	Spring gauge terminal
Enclosure material	ABS	Die-cast aluminium	ABS
Weight	Net weight: 320 g approx.	Net weight: 1 kg approx.	Net weight: 200 g approx.

Notes: 1) Where measurement conditions have not been specified precisely, the conditions used were an ambient temperature of +20 °C +68 °F.

2) If several SF-C11 or SF-C13 units are being used in line together, leave a space of 5 mm 0.197 in or more between each unit. If the units are touching each other, reduce the rated operating current for safety output in accordance with the ambient operating temperature as shown in the graphs at right.

3) Relay switching lifetime will vary depending on factors such as the type of load, the switching frequency, and ambient conditions.


4) The operation indicator is marked as "Enabling" on the unit for SF-C12.

5) Terminals for utilizing the functions of the SF4B series are available.


6) Please switch the sliding switch to the PNP side for minus ground and to the NPN side for plus ground.

7) Refer to p.984 for details of standards.

Dilating when SF-C11 units are mounted close together



Dilating when SF-C13 units are mounted close together



SPECIFICATIONS

Model No.		SF-C14EX(-01) (Note 2)
Item		
Connectable light curtains		SF4B series
Applicable standards		IEC 61496-1, UL 61496-1, EN 61496-1, JIS B 9704-1
Control category		Applicable to Category 4 based on ISO 13849-1 (EN 954-1, JIS B 9705-1)
Supply voltage		24 V DC ± 10 % Ripple P-P 10 % or less
Current consumption		0.2 A or less (Excluding light curtain and other external connecting device)
Safety outputs (Safety output 1 Safety output 2 Safety output 3)		PNP open-collector transistor 2 outputs × 3 or NPN open-collector transistor 2 outputs × 3 (selectable using a slider switch) <When PNP output is selected> • Maximum source current: 200 mA or less • Applied voltage: same as supply voltage (between the safety output and +V) • Residual voltage: 2 V or less (at 200 mA source current) <When NPN output is selected> • Maximum sink current: 200 mA or less • Applied voltage: same as supply voltage (between the safety output and 0 V) • Residual voltage: 2 V or less (at 200 mA sink current)
Operation mode (Output operation)		Safety output 1: ON when the light curtain is in light receiving condition, OFF when the light curtain is in light interrupted condition (Note 3) Safety output 2: ON when the light curtain is in light receiving condition or the muting function is valid OFF when the light curtain is in light interrupted condition and the muting function is invalid (Note 3) Safety output 3: ON when the emergency stop is invalid, OFF when the emergency stop is valid
Protection circuit (Short-circuit protection)		Incorporated
Response time		OFF response: 14 ms or less (Safety output 1 and 2: including the response time of the light curtain) ON response: 90 ms or less (auto-reset) / 140 ms or less (manual reset) (Note 4)
Auxiliary outputs (Auxiliary output 1 Auxiliary output 2 Auxiliary output 3 Auxiliary output 4 (Note 5))		PNP open-collector transistor × 3 or NPN open-collector transistor × 3 (selectable using a slider switch) <When PNP output is selected> • Maximum source current: 60 mA or less • Applied voltage: same as supply voltage (between the auxiliary output and +V) • Residual voltage: 2 V or less (at 60 mA source current) <When NPN output is selected> • Maximum sink current: 60 mA or less • Applied voltage: same as supply voltage (between the auxiliary output and 0 V) • Residual voltage: 2 V or less (at 60 mA sink current)
Operation mode (Output operation)		Auxiliary output 1: ON when the muting function is invalid, OFF when the muting function is valid Auxiliary output 2: ON when the override function is invalid, OFF when the override function is valid Auxiliary output 3: ON when the muting lamp is normal, OFF when the muting lamp is error Auxiliary output 4: ON when the light curtain is in light interrupted condition, OFF when the light curtain is in light receiving condition (Note 5)
Protection circuit (Short-circuit protection)		Incorporated
Muting lamp output		Applicable muting lamp: 24 V DC, 3.6 to 30 W (L1, L2 of each unit)
Protection circuit (Short-circuit protection)		Incorporated
Environmental resistance	Protection	Enclosure: IP40, Terminal: IP20 (Refer to p.984 for details of standards.)
	Ambient temperature	−10 to +55 °C +14 to +131 °F (No dew condensation or icing allowed), Storage: −25 to +70 °C −13 to +158 °F
	Ambient humidity	30 to 85 % RH, Storage: 30 to 95 % RH
	Dielectric strength voltage	1,000 V AC for one min. between all supply terminals connected together and enclosure
	Insulation resistance	20 MΩ, or more, with 500 V DC megger between all supply terminals connected together and enclosure
	Vibration resistance	10 to 55 Hz frequency, 0.35 mm 0.014 in amplitude in X, Y and Z directions for two hours each
	Shock resistance	30 G acceleration in X, Y and Z directions for three times each
Material		Enclosure: ABS
Connection terminal		Detachable spring gauge terminal
Weight		Net weight: 250 g approx.

Notes: 1) Where measurement conditions have not been specified precisely, the conditions used were an ambient temperature of +20 °C +68 °F.

2) **SF-C14EX-01** is Handy-controller non-compatible type.

3) Both safety output 1 and 2 are OFF when the emergency stop is valid regardless of whether the light curtain is in the light receiving or light interrupted condition

4) The auto-reset cannot be used with safety output 3.

5) The auxiliary output incorporated in the **SF4B** series is output.

FIBER
SENSORSLASER
SENSORSPHOTO-
ELECTRICMICRO
PHOTO-

SENSORS

10

COMPONENT

SENSORS

PROXIMITY SENSORS

PARTICULAR USE SENSORS

SENSOR OPTIONS

WIRE- SAVING

MEASURE-
MENT

STATIC

DEVICES

MARKERS

Selection

Light Curtains

CF4D

BSF4-AH8

Control Units


Optical Touch
Switch

SW-10

Product
Definition of

LIGHT CURTAIN WIRING DIAGRAMS**Wiring diagram of SF-C11 and SF4B series or SF2B series (Control category 4 or 2)****For PNP output (minus ground)**


- Set the light curtain input polarity selection switch to the PNP side and ground the 0 V line.

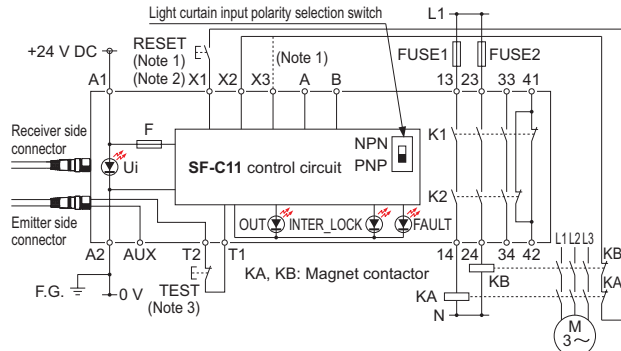


- Notes:
- The above diagram is when using manual reset. If automatic reset is used, disconnect the lead from X2 and connect it to X3. In this case, a reset (RESET) button is not needed.
 - Use a momentary-type switch as the reset (RESET) button.
 - Emission halt occurs when the test (TEST) button is open, and emission occurs when the test (TEST) button is short-circuited. If not using the test (TEST) button, short-circuit T1 and T2. However, use a test rod or similar to interrupt the light in order to carry out self-diagnosis separately.

For NPN output (plus ground)

- In the above diagram, set the light curtain input polarity selection switch to the NPN side and ground the + side.

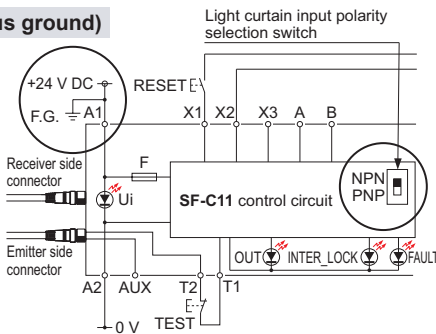**Wiring diagram of SF-C12 and SF4B series (Control category 4)****For PNP output (minus ground)**

- Set the two light curtain input polarity selection switches to the PNP side and connect the FG terminal to the 0 V line.

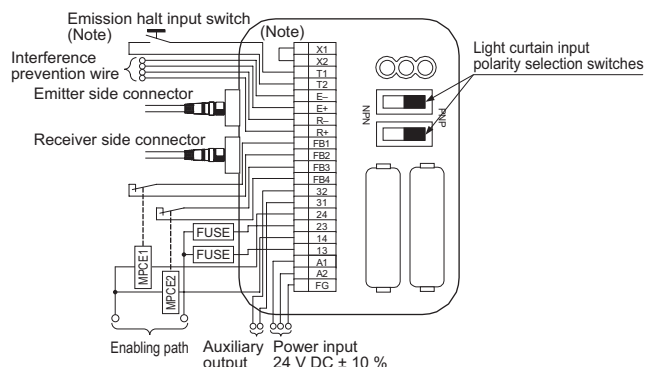


Note: The above diagram is when using manual reset. If automatic reset is used, connect a normal close-type pushbutton switch between T1 and T2 and leave between X1 and X2 open.


For NPN output (plus ground)

- In the above diagram, set the two light curtain input polarity selection switches to the NPN side and connect the FG terminal to the + side.

When connecting the **SF-C11** to the light curtains, make sure to use the 8-core connection cable with a connector. Refer to the **SF4B** series (p.481~) and **SF2B** series (p.515~) for details. **SFB-CB**, **SF2B-CB**, **SFB-CCJ10**

Terminal arrangement diagram

Terminal	Function
A1	+24 V DC
A2	0 V
13-14, 23-24, 33-34	Enabling path (NO contact × 3)
41-42	Auxiliary output (NC contact × 1)
X1	Reset output terminal
X2	Reset input terminal (Manual)
X3	Reset input terminal (Automatic)
A	Not used
B	
T1	Test output terminal
T2	Test input terminal
AUX	Semiconductor auxiliary output

Pin layout for light curtain connectors

Connector pin No.	Emitter side connector	Receiver side connector
①	Interlock (Note)	OSSD2
②	+24 V DC	+24 V DC
③	Emission halt	OSSD1
④	Auxiliary output	EDM (External relay monitor)
⑤	Synchronization wire +	Synchronization wire +
⑥	Synchronization wire -	Synchronization wire -
⑦	0 V	0 V
⑧	Shielded wire	Shielded wire


Note: It is not used with the **SF2B** series.

When connecting the **SF-C12** to the light curtains, make sure to use the 12-core connection cable with a connector. Refer to the **SF4B** series (p.481~) for details.
SFB-CB05-MU (Cable length: 0.5 m **1.640 ft**)
SFB-CCJ10E-MU (Extension cable for emitter, cable length: 10 m **32.808 ft**)
SFB-CCJ10D-MU (Extension cable for receiver, cable length: 10 m **32.808 ft**)

Terminal arrangement diagram

X1	X2	X3	A	B	T1	T2	AUX	FG
----	----	----	---	---	----	----	-----	----

Terminal	Function	Terminal	Function
FG	Frame ground (F.G.) terminal	R+	Interference prevention wire - (Receiver side)
A2	0 V	R-	Interference prevention wire + (Receiver side)
A1	+24 V DC	E+	Interference prevention wire - (Emitter side)
13-14, 23-24	Enabling path (NO contact × 2)	E-	Interference prevention wire + (Emitter side)
31-32	Auxiliary output (NC contact × 1)	T2	Emission halt input terminal
FB4	External relay monitor terminal 2	X2	Automatic reset / manual reset selection terminal
FB2	External relay monitor terminal 1	X1	Manual reset: X1 - X2 short-circuited
FB1			


Pin layout for light curtain connectors

Note: Input and output for pin Nos. ⑪ and ⑫ are not used by this product

Connector pin No.	Emitter side connector	Receiver side connector
①	Interlock	OSSD2
②	+24 V DC	+24 V DC
③	Emission halt	OSSD1
④	Auxiliary output	EDM (External relay monitor)
⑤	Synchronization wire +	Synchronization wire +
⑥	Synchronization wire -	Synchronization wire -
⑦	0 V	0 V
⑧	Shielded wire	Shielded wire
⑨	Interference prevention wire +	Interference prevention wire +
⑩	Interference prevention wire -	Interference prevention wire -
⑪	(Muting lamp output)	(Muting input 1)
⑫	(Override input)	(Muting input 2)

LIGHT CURTAIN WIRING DIAGRAMS**Wiring diagram of SF-C13 and SF4B series or SF2B series (Control category 4 or 2)****For PNP output (minus ground)**


- Connect the light curtain control outputs OSSD1 and OSSD2 to S1 and S2 respectively.

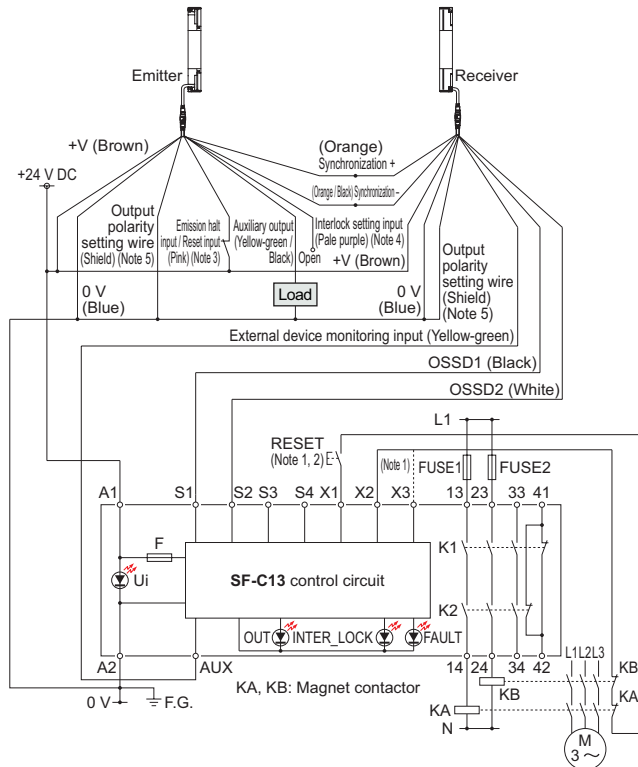

- Notes: 1) The above diagram is when using manual reset. If automatic reset is used, disconnect the lead from X2 and connect it to X3. In this case, a reset (RESET) button is not needed.
 2) Use a momentary-type switch as the reset (RESET) button.
 3) This is a test input (pink) for the **SF2B** series.
 4) This is not equipped on the **SF2B** series.
 5) This is a shield for the **SF2B** series. Output polarity cannot be set.

For NPN output (plus ground)

- Connect the light curtain control outputs OSSD1 and OSSD2 to S4 and S2 respectively and ground the + side.

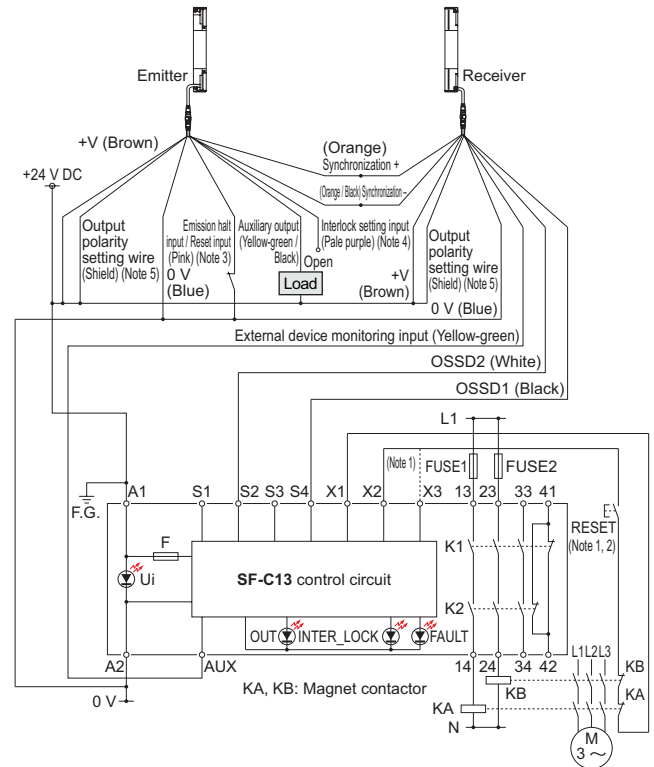

- Notes: 1) The above diagram is when using manual reset. If automatic reset is used, disconnect the lead from X2 and connect it to X3. In this case, a reset (RESET) button is not needed.
 2) Use a momentary-type switch as the reset (RESET) button.
 3) This is a test input (pink) for the **SF2B** series.
 4) This is not equipped on the **SF2B** series.
 5) This is a shield for the **SF2B** series. Output polarity cannot be set.

Terminal arrangement diagram

Terminal	Function
A1	+24 V DC
A2	0 V
S1 to S4	Light curtain control output (OSSD) input terminal
AUX	Semiconductor auxiliary output
X1	Reset output terminal
X2	Reset input terminal (Manual)
X3	Reset input terminal (Automatic)
13-14, 23-24, 33-34	Enabling path (NO contact × 3)
41-42	Auxiliary output (NC contact × 1)


Use a separate terminal block to carry out wiring for light curtains that cannot be connected to the **SF-C13**.

When connecting the **SF-C13** to the light curtains, make sure to use a discrete wire connection cable. Refer to the **SF4B** series (p.481~) and **SF2B** series (p.515~) for details.
SFB-CCB(-MU), **SF2B-CCB**, **SFB-CC(-MU)**


FIBER
SENSORSLASER
SENSORSPHOTO-
ELECTRIC
SENSORSMICRO
PHOTO-
ELECTRIC
SENSORSAREA
SENSORSSAFETY
COMPONENTSPRESSURE
SENSORSINDUCTIVE
PROXIMITY
SENSORSPARTICULAR
USE
SENSORSSENSOR
OPTIONSWIRE-
SAVING
SYSTEMSMEASURE-
MENT
SENSORSSTATIC
CONTROL
DEVICESLASER
MARKERSSelection
GuideLight
Curtains**SF4B****SF2B****BSF4-AH80**Control
Units**SF-C10**Optical Touch
Switch**SW-101**Other
ProductsDefinition of
Sensing Heights

LIGHT CURTAIN WIRING DIAGRAMS**Wiring diagram of SF-C14EX and SF4B series (Control category 4)****For PNP output (minus ground)**

- Set the output polarity selection switch to the PNP side and ground the 0 V line.

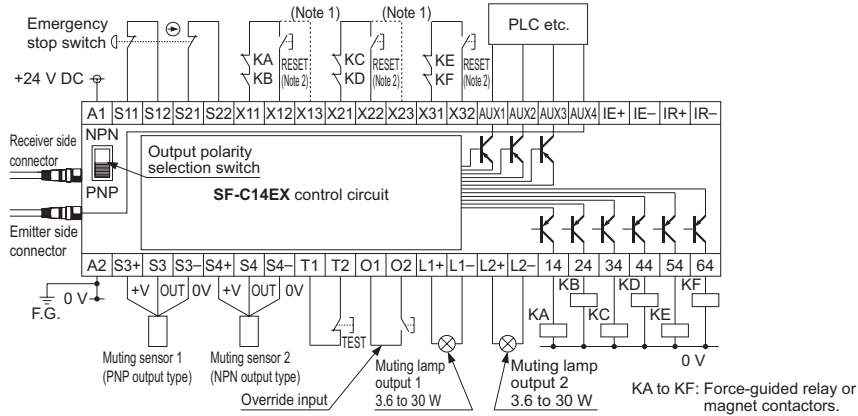

- When connecting the **SF-C14EX** to the light curtains, make sure to use the following connecting cable.
- SFB-CB05-EX** (Cable length: 0.5 m **1.640 ft**)
- SFB-CB5-EX** (Cable length: 5 m **16.404 ft**)
- SFB-CB10-EX** (Cable length: 10 m **32.808 ft**)
- If the NO (Normally Open) contact switch is used as a muting sensor, wire it as shown in the figure below.




- If the emergency stop switch is not used, short-circuit between the terminals S11 to S12 and S21 to S22 directly.


Notes: 1) The above diagram is when using manual reset. If automatic reset is used, disconnect the lead from X12 and X22, and connect them to X13 and X23 as shown by the dotted lines. In this case, a reset (RESET) button is not needed. Terminals X31 to X32 are for manual reset only.
2) Use a momentary-type switch for the reset (RESET) button.

For NPN output (plus ground)


- Set the output polarity selection switch to the NPN side and ground the + side of the power supply input.

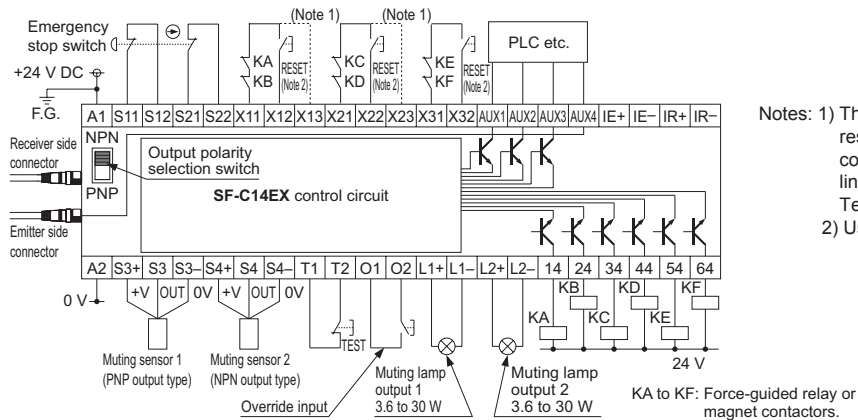

Notes: 1) The left diagram is when using manual reset. If automatic reset is used, disconnect the lead from X12 and X22, and connect them to X13 and X23 as shown by the dotted lines. In this case, a reset (RESET) button is not needed. Terminals X31 to X32 are for manual reset only.
2) Use a momentary-type switch for the reset (RESET) button.

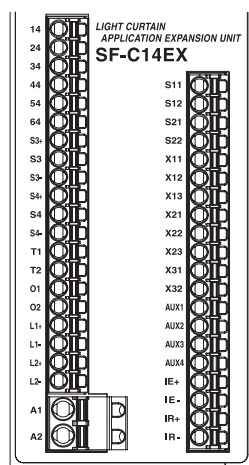Terminal arrangement diagram


Terminal	Function	Terminal	Function
14	Safety output 1, Light received / Light interrupted output of the light curtain	S11	Emergency stop contact input
24		S12	2 NC input
34	Safety output 2, Light curtain output including the muting function	S21	Between S11 and S12
44		S22	Between S21 and S22
54	Safety output 3	X11	Safety output 1 reset input
64	Emergency stop output	X12	X11 - X12: Manual reset
S3+	Muting sensor input 1 (PNP output type)	X13	X11 - X13: Auto-reset
S3-	S3+, S3-: Power supply	X21	Safety output 2 reset input
S3-	S3: Sensor output	X22	X21 - X22: Manual reset
S4+	Muting sensor input 2 (NPN output type)	X23	X21 - X23: Auto-reset
S4-	S4+, S4-: Power supply	X31	Safety output 3 reset input
S4-	S4: Sensor output	X32	X31 - X32: Manual reset
T1	Test input terminal	AUX1	Auxiliary output 1, Muting output
T2	Open: Test mode	AUX2	Auxiliary output 2, Override output
O1	Short-circuit: Normal operation	AUX3	Auxiliary output 3, Blown lamp output
O1	Override input terminal	AUX4	Auxiliary output 4, Light curtain auxiliary output
O2	Open: Invalid	IE+	Interference prevention terminal, Emitter side +
O2	Short-circuit: Valid	IE-	Interference prevention terminal, Emitter side -
L1+	Muting lamp output 1	IR+	Interference prevention terminal, Receiver side +
L1-		IR-	Interference prevention terminal, Receiver side -
L2+	Muting lamp output 2		
L2-			
A1	+24 V DC		
A2	0 V		

Pin layout for light curtain connectors

Connector pin No.	Emitter side connector	Receiver side connector
①	Interference prevention wire +	Interference prevention wire +
②	+24 V DC	+24 V DC
③	Interference prevention wire -	Interference prevention wire -
④	Auxiliary output	Not used
⑤	Synchronization wire +	Synchronization wire +
⑥	Synchronization wire -	Synchronization wire -
⑦	0 V	0 V
⑧	Shielded wire	Shielded wire

PRECAUTIONS FOR PROPER USE

Refer to P.1027 for general precautions.

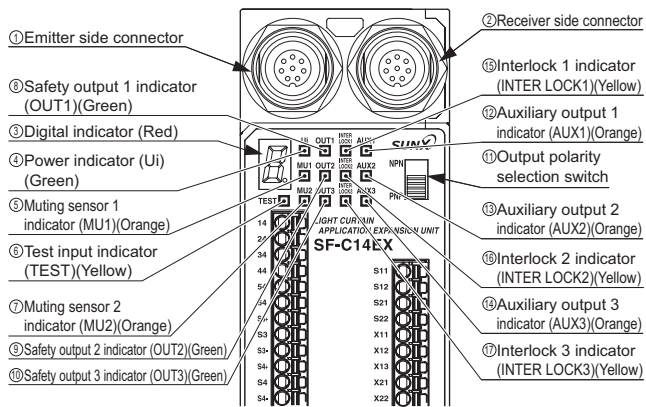Part description and function (SF-C14EX)

No.	Description	Function
①	Emitter side connector	The emitter of SF4B series is connected.
②	Receiver side connector	The receiver of SF4B series is connected.
③	Digital indicator (Red)	Lights up or blinks when there is a problem. Lights up when blanking function is enabled.
④	Power indicator (Ui) (Green)	Lights up when the power is ON.
⑤	Test input indicator (TEST) (Yellow)	Lights up when test input is enabled. Blinks while communication with SFB-HC handy-controller is in progress.
⑥	Muting sensor 1 indicator (MU1) (Orange)	Lights up when muting sensor 1 is ON.
⑦	Muting sensor 2 indicator (MU2) (Orange)	Lights up when muting sensor 2 is ON.
⑧	Safety output 1 indicator (OUT1) (Green)	Lights up when safety output 1 is ON.
⑨	Safety output 2 indicator (OUT2) (Green)	Lights up when safety output 2 is ON.
⑩	Safety output 3 indicator (OUT3) (Green)	Lights up when safety output 3 is ON.
⑪	Output polarity selection switch	PNP (minus ground) or NPN (plus ground) can be selected. The factory setting is PNP (minus ground).
⑫	Auxiliary output 1 indicator (AUX1) (Orange)	Lights up when auxiliary output 1 is ON.
⑬	Auxiliary output 2 indicator (AUX2) (Orange)	Lights up when auxiliary output 2 is ON.
⑭	Auxiliary output 3 indicator (AUX3) (Orange)	Lights up when auxiliary output 3 is ON.
⑮	Interlock 1 indicator (INTER LOCK1) (Yellow)	Lights up when interlock 1 is ON.
⑯	Interlock 2 indicator (INTER LOCK2) (Yellow)	Lights up when interlock 2 is ON.
⑰	Interlock 3 indicator (INTER LOCK3) (Yellow)	Lights up when interlock 3 is ON.

Wiring

- The following solid wire and twisted wires (lead wire) are recommended.

SF-C11

Power supply and output line connector: 0.2 to 2.5mm² (AWG24 to 12)
 Signal line connector: 0.2 to 1.5mm² (AWG24 to 16)

SF-C13

Single wire: $\varnothing 0.4$ to $\varnothing 1.2$ mm $\varnothing 0.016$ to $\varnothing 0.047$ in (AWG26 to 16)
 Twisted wire (lead wire) : 0.3 to 1.25mm² (AWG22 to 16)

SF-C14EX(-01)

Power supply line connector (A1, A2) : 0.2 to 2.5mm² (AWG24 to 12)
 Other connectors: 0.2 to 1.5mm² (AWG24 to 16)

Output waveform (Safety output ON) [SF-C14EX(-01)]


- When safety output is ON, self-diagnosis of the output circuit is carried out, so that the output transistor will periodically turn OFF. (OFF pulse width: 100 μ s or less) When the OFF signal is fed back, the receiver judges the output circuit as normal. When the OFF signal is not fed back, the receiver judges either the output circuit or wiring as error, and the safety output maintains OFF status.



Since the OFF signal of **SF-C14EX** might cause malfunction, perform the connecting paying attention to the input response time of the machine to be connected to **SF-C14EX**.

Time chart [SF-C14EX(-01)]**Normal operation**

- The diagram shows operation with safety outputs 1 and 2 in manual-reset mode.

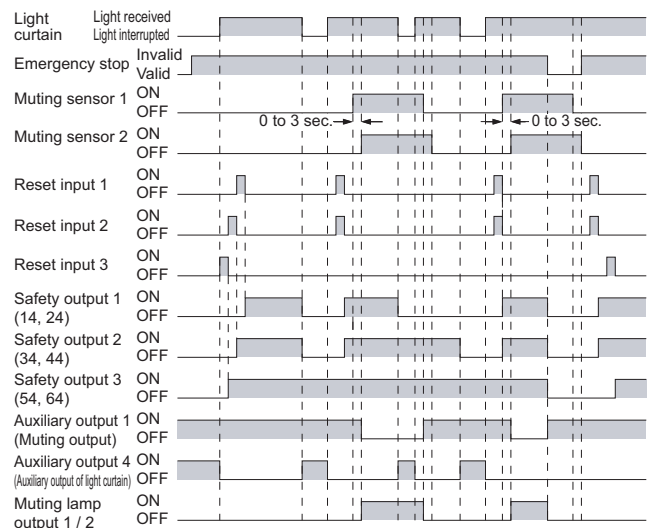

- The diagram above is the timing chart of **SF-C14EX(-01)** in normal operation.
- In normal operation, auxiliary output 2 (override output) is maintained in the ON state.
- In normal operation, auxiliary output 3 (muting lamp output) is maintained in the ON state.

FIBER SENSORS

LASER SENSORS

PHOTO-ELECTRIC SENSORS

MICRO PHOTO-ELECTRIC SENSORS

AREA SENSORS

SAFETY COMPONENTS

PRESSURE SENSORS

INDUCTIVE PROXIMITY SENSORS

PARTICULAR USE SENSORS

SENSOR OPTIONS

WIRE- SAVING SYSTEMS

MEASURE- MENT SENSORS

STATIC CONTROL DEVICES

LASER MARKERS

Selection Guide

Light Curtains

SF4B**SF2B****BSF4-AH80**

Control Units

SF-C10

Optical Touch Switch

SW-101

Other Products

Definition of Sensing Heights


PRECAUTIONS FOR PROPER USE

Refer to P.1027 for general precautions.

Time chart [SF-C14EX(-01)]

Test input, Override input

- The diagram shows operation with safety outputs 1 and 2 in auto-reset mode.

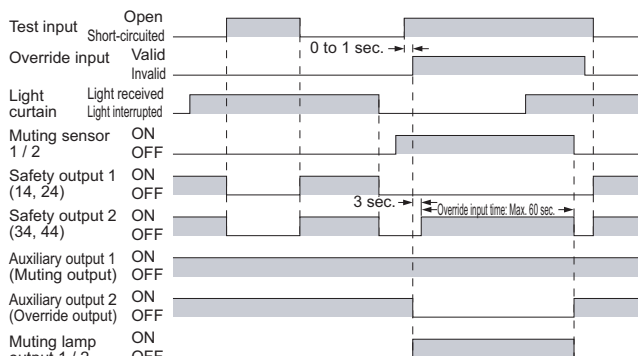


- Safety outputs 1 and 2 are OFF during test input.
- The override function becomes valid when all the conditions listed below are satisfied:
 - An incandescent lamp with 3.6 to 30 W is at least connected to either muting lamp output 1 or 2.
 - The signal is input to either muting sensor 1 or 2.
 - The override input terminal O1 and O2 is short-circuited and the test input terminal T1 / T2 is opened within 1 sec. (3 sec. continuously)

If one of the three conditions above becomes invalid or the timing exceeds 60 sec., the override function becomes invalid.

Blown lamp output

- The diagram shows operation with safety outputs 1 and 2 in auto-reset mode.

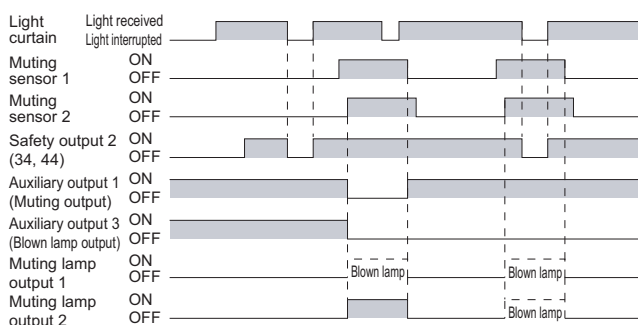

- The lamps are monitored during muting state, and if either of them breaks, auxiliary output 3 is turned OFF. If only one lamp breaks, the muting state is maintained, however, if both lamps break, the muting state is canceled immediately.

Others

- When connecting this product to a product other than the connectable input device, the system does not conform to the control category 4 based on ISO 13849-1 (EN 954-1, JIS B 9705-1).
- The power supply unit of **SF-C10** series uses the electronic fuse which does not require any replacement.
- When the electronic fuse trips, turn off the power supply and eliminate the cause for the overcurrent. After that, turn the power back on.
- The electronic fuse is not meant to be used for equipment that is operated continuously. Note that the specification may not be satisfied by continuous operation.

- Make sure to carry out the wiring in the power supply off condition.
- Wrong wiring will damage the product.
- Verify that the supply voltage variation is within the rating. Note that if a voltage exceeding the rated range is applied, or if an AC power supply is directly connected, the unit may get burnt or damaged.
- The DC power supply unit must satisfy the conditions given below:
 - Power supply unit authorized in the region where this device is to be used.
 - Power supply unit conforming to EMC Directive and Low-voltage Directive (In case CE conformity is required.)
 - Power supply unit conforming to the Low-voltage Directive and with an output of 100 VA or less.
 - The frame ground (F.G.) terminal must be connected to ground when using a commercially available switching regulator.
 - Power supply unit with an output holding time of 20 ms or more.
 - Use an isolation transformer for the DC power supply unit.
 - If surges are likely to occur, take countermeasures such as connecting a surge absorber to the origin of the surge.
 - Power supply unit corresponding to CLASS 2 (In case UL / c UL conformity is required.)

<Additional information>

As provided in IEC 60536 (CLASS: Protection against Electric Shock), this power supply should require no ground earth and satisfy the insulation distance by double insulation or reinforced insulation.

(If the power supply conforms to Low-voltage Directive (and has an output of 100 VA or less, it can be used as a suitable product.)

Do not run the wires together with high-voltage lines or power lines or put them in the same raceway. This can cause malfunction due to induction.

- This product is not dust-proof / splash proof. Be sure to put this product into a control box having IP54 construction. (Excluding **SF-C12**)
- Avoid dust, dirt and steam.
- Take care that the product does not come in direct contact with oil, grease, or organic solvents, such as, thinner, etc.
- Note that this equipment is applicable only in the control circuit grounded in accordance with IEC 60204-1 and JIS B 9960-1, or in the control circuit in which the insulation monitor unit (ground fault detection unit) is included.
- This unit is suitable for indoor use only.
- The seal as shown in the drawing on the below is stuck to the engagement point of unit. If the seal is peeled off or broken, **SF-C10** series will not be certified as "Safety equipment" and will not be covered by our guarantee.


Do not open!

If this seal is removed or damaged, the units are not recognized as safety product.


SUNX Ltd.

DIMENSIONS (Unit: mm in)The CAD data in the dimensions can be downloaded from the SUNX website: <http://www.sunx.com>**SF-C11**


Control unit (Optional)

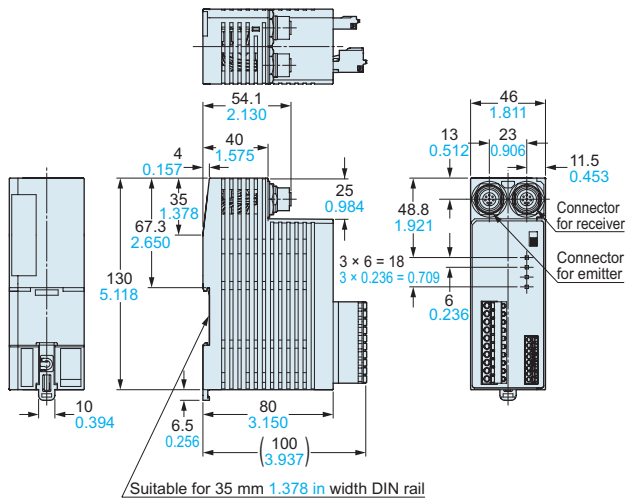**SF-C12**


Control unit (Optional)

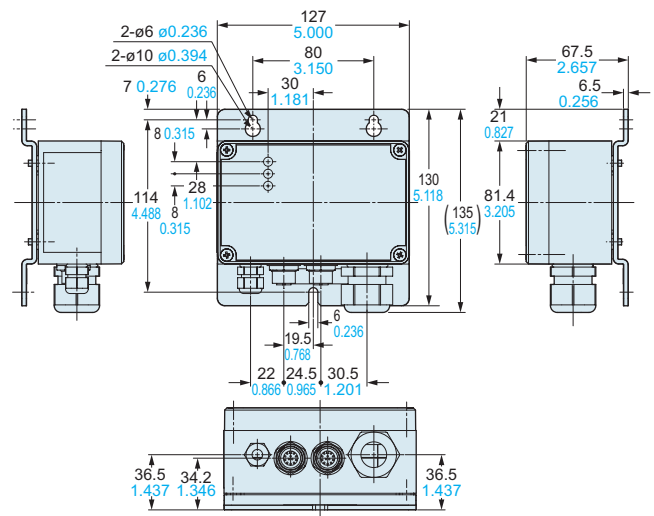**SF-C13**

Control unit (Optional)

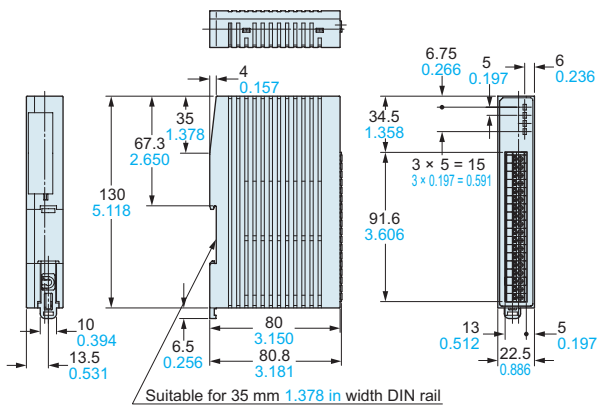**SF-C14EX(-01)**

Application expansion unit

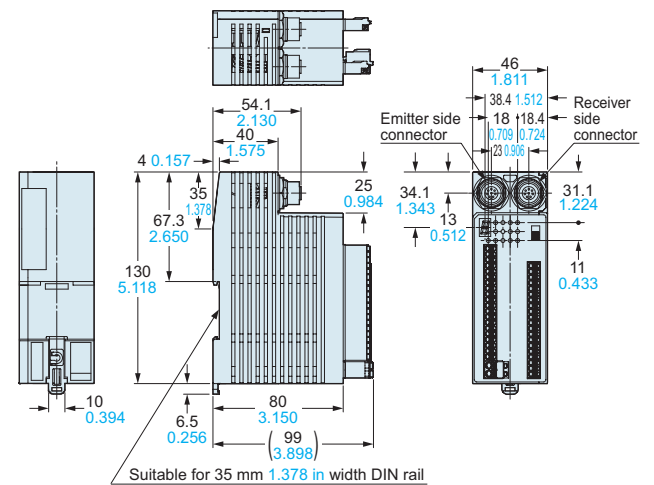FIBER
SENSORSLASER
SENSORSPHOTO-
ELECTRIC
SENSORSMICRO
PHOTO-
ELECTRIC
SENSORSAREA
SENSORSSAFETY
COMPONENTSPRESSURE
SENSORSINDUCTIVE
PROXIMITY
SENSORSPARTICULAR
USE
SENSORSSENSOR
OPTIONSWIRE-
SAVING
SYSTEMSMEASURE-
MENT
SENSORSSTATIC
CONTROL
DEVICESLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERSLASER
MARKERS